

# Technical Evaluation Report™

**TER 1703-04**

Starborn® Structural H19, F19 and F23 Screws:  
Cladding Attachment Through Foam Sheathing

**Starborn® Industries, Inc.**

**Product:**

**Starborn® Structural H19  
Screws, Starborn® Structural  
F19 Screws and Starborn®  
Structural F23 Screws**

Issue Date:

November 7, 2019

Revision Date:

August 3, 2023

Subject to Renewal:

January 1, 2024



Use the QR code to access the most recent version or a sealed  
copy of this Technical Evaluation Report (TER) at [drjcertification.org](https://drjcertification.org).



COMPANY  
INFORMATION:

ADDITIONAL  
LISTEES:

Starborn® Industries, Inc.  
45 Mayfield Ave  
Edison, NJ 08837-3820

P: 800-596-7747  
F: 732-381-9830

[info@starbornindustries.com](mailto:info@starbornindustries.com)

[starbornindustries.com](http://starbornindustries.com)

DIVISION: 06 00 00 - WOOD, PLASTICS AND COMPOSITES

SECTION: 06 05 23 - Wood, Plastic, and Composite Fastenings

**1 Innovative Product Evaluated<sup>1,2</sup>**

- 1.1 Starborn® Structural H19 Screws
- 1.2 Starborn® Structural F19 Screws
- 1.3 Starborn® Structural F23 Screws

**2 Applicable Codes and Standards<sup>3,4</sup>**

**2.1 Codes**

- 2.1.1 *IBC—15, 18, 21: International Building Code®*
- 2.1.2 *IRC—15, 18, 21: International Residential Code®*

**2.2 Standards and Referenced Documents**

- 2.2.1 *ANSI/AWC NDS: National Design Specification (NDS) for Wood Construction*
- 2.2.2 *ASTM A153: Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware*
- 2.2.3 *ASTM C578: Standard Specification for Rigid, Cellular Polystyrene Thermal Insulation*
- 2.2.4 *ASTM C1289: Standard Specification for Faced Rigid Cellular Polyisocyanurate Thermal Insulation Board*

<sup>1</sup> For more information, visit [drjcertification.org](http://drjcertification.org) or call us at 608-310-6748.

<sup>2</sup> 24 CFR 3280.2 "Listed or certified" means included in a list published by a nationally recognized testing laboratory, inspection agency, or other organization concerned with product evaluation that maintains periodic inspection of production of listed equipment or materials, and whose listing states either that the equipment or material meets nationally recognized standards or has been tested and found suitable for use in a specified manner. Listed. Equipment, materials, products or services included in a list published by an organization acceptable to the building official and concerned with evaluation of products or services that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services and whose Listing states either that the equipment, material, product or service meets identified standards or has been tested and found suitable for a specified purpose. Labeled. Equipment, materials or products to which has been affixed a label, seal, symbol or other identifying mark of a nationally recognized testing laboratory, approved agency or other organization concerned with product evaluation that maintains periodic inspection of the production of the above-labeled items and whose labeling indicates either that the equipment, material or product meets identified standards or has been tested and found suitable for a specified purpose.

<sup>3</sup> This Listing is a code defined research report, which is also known as a duly authenticated report, provided by an approved agency (see IBC Section 1703.1) and/or an approved source (see IBC Section 1703.4.2). An approved agency is "approved" as an approved agency when it is ANAB accredited. DrJ Engineering, LLC (DrJ) is listed in the ANAB directory. A professional engineer is "approved" as an approved source when that professional engineer is properly licensed to transact engineering commerce. Where sealed by a professional engineer, it is also a duly authenticated report certified by an approved source. (i.e., Registered Design Professional). DrJ is an ANAB accredited product certification body.

<sup>4</sup> Unless otherwise noted, all references in this Listing are from the 2021 version of the codes and the standards referenced therein. This material, product, design, service and/or method of construction also complies with the 2000-2021 versions of the referenced codes and the standards referenced therein.

### 3 Performance Evaluation

- 3.1 Tests, test reports, research reports, duly authenticated reports and related engineering evaluations are defined as intellectual property and/or trade secrets and protected by Defend Trade Secrets Act 2016 (DTSA).<sup>5</sup>
- 3.2 Testing and/or inspections conducted for this TER were performed at an ISO/IEC 17025 accredited testing laboratory,<sup>6</sup> an ISO/IEC 17020 accredited inspection body,<sup>7</sup> which are internationally recognized accreditations through International Accreditation Forum (IAF), and/or a licensed Registered Design Professional (RDP).
- 3.3 Starborn® Structural H19, F19 and F23 screws were evaluated for their ability to support the gravity and transverse loads in the application of cladding attachment over foam sheathing in wood-frame construction.
- 3.4 Use of fasteners in locations exposed to saltwater or saltwater spray is outside the scope of this evaluation report.
- 3.5 Any building code and/or accepted engineering evaluations (i.e. research reports, duly authenticated reports, etc.) that are conducted for this Listing were performed by DrJ Engineering, LLC (DrJ), an ISO/IEC 17065 accredited certification body and a professional engineering company operated by RDPs / approved sources. DrJ is qualified<sup>8</sup> to practice product and code compliance services within its scope of accreditation and engineering expertise, respectively.
- 3.6 Engineering evaluations are conducted with DrJ's ANAB accredited ICS code scope, which are also its areas of professional engineering competence.
- 3.7 Any regulation specific issues not addressed in this section are outside the scope of this TER.

<sup>5</sup> <https://www.law.cornell.edu/uscode/text/18/part-II/chapter-90>. Whoever, with intent to convert a trade secret, that is related to a product or service used in or intended for use in or intended for use in interstate or foreign commerce, to the economic benefit or anyone other than the owner thereof, and intending or knowing that the offense will injure any owner of that trade secret, knowingly (1) steals, or without authorization appropriates, takes, carries away, or conceals, or by fraud, artifice, or deception obtains such information; (2) without authorization copies, duplicates, sketches, draws, photographs, downloads, uploads, alters, destroys, photocopies, replicates, transmits, delivers, sends, mails, communicates, or conveys such information; (3) receives, buys, or possesses such information, knowing the same to have been stolen or appropriated, obtained, or converted without authorization; (4) attempts to commit any offense described in paragraphs (1) through (3); or (5) conspires with one or more other persons to commit any offense described in paragraphs (1) through (3), and one or more of such persons do any act to effect the object of the conspiracy, shall, except as provided in subsection (b), be fined under this title or imprisoned not more than 10 years, or both. (b) Any organization that commits any offense described in subsection (a) shall be fined not more than the greater of \$5,000,000 or 3 times the value of the stolen trade secret to the organization, including expenses for research and design and other costs of reproducing the trade secret that the organization has thereby avoided. The federal government and each state have a public records act. As the National Society of Professional Engineers states, "Engineers shall not disclose, without consent, confidential information concerning the business affairs or technical processes of any present or former client or employer, or public body on which they serve." Therefore, to protect intellectual property (IP) and TS, and to achieve compliance with public records and trade secret legislation, requires approval through the use of Listings, certified reports, technical evaluation reports, duly authenticated reports and/or research reports prepared by approved agencies and/or approved sources.

<sup>6</sup> Internationally recognized accreditations are performed by members of the International Accreditation Forum (IAF). Accreditation Body and Regional Accreditation Group Members of IAF are admitted to the IAF MLA only after a stringent evaluation of their operations by a peer evaluation team, which is charged to ensure that the applicant complies fully with both international standards and IAF requirements. Once an accreditation body is a signatory of the IAF MLA, it is required to recognise certificates and validation and verification statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA, with the appropriate scope.

<sup>7</sup> Ibid.

<sup>8</sup> Qualification is performed by a legislatively defined Accreditation Body. ANSI National Accreditation Board (ANAB) is the largest independent accreditation body in North America and provides services in more than 75 countries. DrJ is an ANAB accredited product certification body.

## 4 Product Description and Materials

### 4.1 General

- 4.1.1 Starborn® Structural H19, F19 and F23 screws are alternate dowel-type threaded fasteners designed for use in attaching cladding over foam sheathing applications. The fasteners listed in Table 1 are evaluated in this TER.

**Table 1.** Starborn® Structural Fastener Designation and Product Name

Product Name	Unthreaded Shank Diameter <sup>1</sup> (in)	Head Type	Coating Type (Application)
Structural H19	0.19	Hex ( <sup>5</sup> / <sub>16</sub> in)	Exterior Use
Structural F19		Flat (T-30)	
Structural F23	0.23	Flat (T-40)	
SI: 1 in = 25.4 mm			
1. Unthreaded shank diameter is measured on uncoated parts. Finished part dimensions are larger due to the thickness of the proprietary coating.			

### 4.2 Fastener Material

- 4.2.1 Starborn® Structural H19, F19 and F23 screws are manufactured with heat-treated carbon steel grade 10B21 wire using a standard cold-forming process. All fasteners are produced in accordance with the approved quality control procedures referred to in Section 9.

### 4.3 Fastener Coatings

- 4.3.1 Starborn® Structural H19, F19 and F23 screws are designed for exterior use and may be used where fasteners are required to exhibit corrosion resistance when exposed to adverse environmental conditions and/or in preservative treated wood subject to the limitations of Section 9. These fasteners are alternates to hot-dip-zinc-galvanized fasteners. They feature a proprietary coating system that meets or exceeds the corrosion protection of hot dipped galvanizing per ASTM A153 in accordance with [IBC Section 2304.10](#) and [IRC Section R317.3](#).
- 4.3.1.1 Starborn® Structural H19, F19 and F23 screws were evaluated for use in wood chemically treated with waterborne alkaline copper quaternary, type D (ACQ-D).
- 4.3.1.2 Starborn® Structural H19, F19 and F23 screws are approved for use in fire-retardant-treated lumber, provided the conditions set forth by the fire-retardant-treated lumber manufacturer are met, including appropriate strength reductions.

### 4.4 Wood Members


- 4.4.1 Solid sawn wood members connected with Starborn® Structural H19, F19 and F23 screws shall consist of lumber species or species combinations having a specific gravity of 0.42 to 0.55.
- 4.4.2 Structural composite lumber (i.e., LVL, LSL, PSL, etc.) connected with Starborn® Structural H19, F19 and F23 screws shall be recognized in evaluation reports having published equivalent specific gravities for lateral and withdrawal resistance. Equivalent specific gravities for structural composite lumber may be used in the design of connections using the specific gravities of the sawn lumber shown in Table 3 and Table 4.

#### 4.5 Fastener Specifications


4.5.1 The fasteners evaluated in this TER are specified in Table 2, Figure 1, Figure 2 and Figure 3.

**Table 2.** Fastener Specifications


Product Name	Head Marking	Fastener Length (in)	Thread Length (in)	Unthreaded Shank Diameter <sup>1</sup> (in)	Thread Diameter (in)		Nominal Bending Yield (f <sub>yb</sub> ) (psi)	Allowable Fastener Strength (lbf)				
					Minor <sup>2</sup>	Major		Tensile	Shear			
Structural H19	D19 2.9	2⅞	1.4	0.189	0.169	0.260	196,700	1,280	1,085			
	D19 4	4	2¼									
	D19 6	6	2½									
	D19 8	8										
Structural F19	D19 2.9	2⅞	2				0.189	0.169	0.260	192,880	1,495	1,016
	D19 4.5	4½										
	D19 6	6										
	D19 8	8										
	D19 10	10										
	D19 12	12										
	D19 14	14										
	D19 16	16										
Structural F23	D23 2.9	2⅞	1.4	0.229	0.209	0.307	183,155	1,980	1,490			
	D23 4	4	2⅝									
	D23 5	5	3									
	D23 6	6	2¾									
	D23 8	8										
SI: 1 in = 25.4 mm, 1 lb = 4.45 N, 1 psi = 0.00689 MPa												
1. Unthreaded shank diameter is measured on uncoated parts. Finished part dimensions are larger due to the thickness of the proprietary coating.												
2. Minor thread diameter is calculated as the average value of upper and lower manufacturing tolerances.												

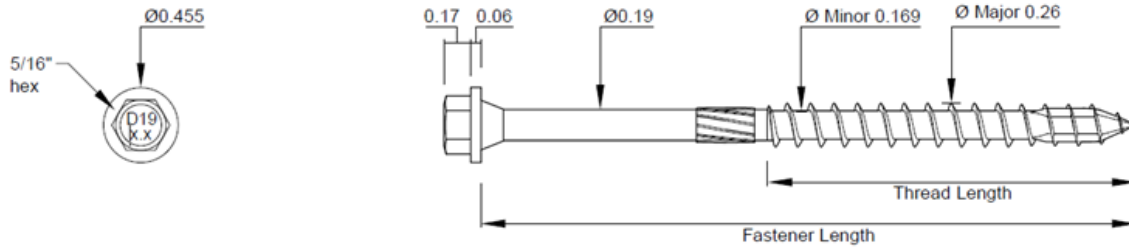

**Figure 1.** Starborn® Structural H19 Screw

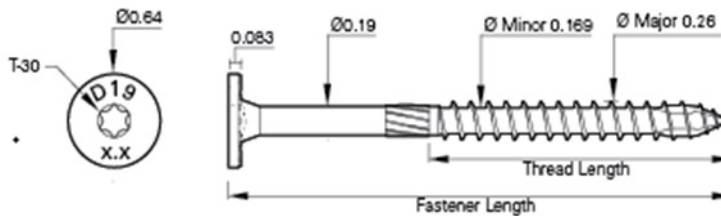

**Figure 2.** Starborn® Structural F19 Screw

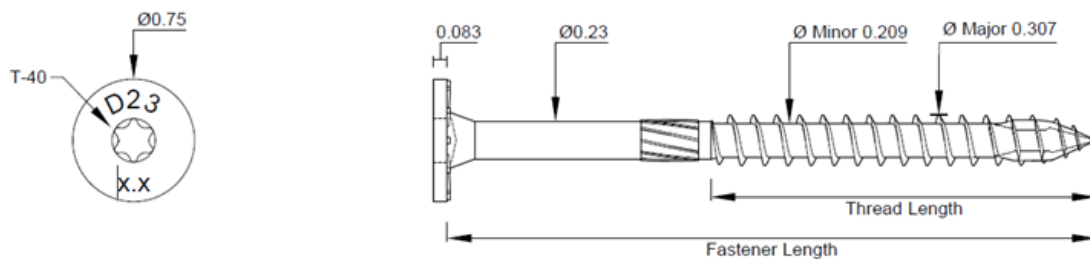

**Figure 3.** Starborn® Structural F23 Screw

## 5 Applications

### 5.1 General

- 5.1.1 Starborn® Structural H19, F19 and F23 screws are self-tapping fasteners used to attach wall sheathing, furring, and/or cladding to the wall framing through an intermediate layer of foam sheathing to provide resistance to transverse loads in conventional light-frame wood construction.
- 5.1.2 Starborn® Structural H19, F19 and F23 screws can be used to support the dead load of wall sheathing, furring, and/or cladding when connected to the wall framing through an intermediate layer of foam sheathing.
- 5.1.3 Starborn® Structural H19, F19 and F23 screws can be used in applications including structural and general timber construction work.
- 5.1.4 Starborn® Structural H19, F19 and F23 screws are installed without lead holes, as prescribed in NDS.

### 5.1.5 Design

- 5.1.5.1 Design of the Starborn® Structural H19, F19 and F23 screws are governed by the applicable code and the provisions for dowel type fasteners in NDS.
- 5.1.5.2 Unless otherwise noted, adjustment of the design stresses for duration of load shall be in accordance with the applicable code.



## 5.2 Fastening Cladding Over Foam Sheathing

5.2.1 Refer to Table 3 and Table 4 for recommended fastener spacing for cladding over foam.

## 5.3 Design Procedure

5.3.1 Calculate the fastener spacing:

**Step 1:** Determine the spacing between studs or framing members, either 16" or 24" o.c. (on-center).

**Step 2:** Calculate the correct thickness of rigid foam, up to 4", needed to obtain the required insulation effect or R-value.

**Step 3:** Choose the furring or sheathing (substrate) material to which the cladding will be affixed:

1. Minimum  $\frac{3}{4}$ " x  $3\frac{1}{2}$ " wood furring
2. Minimum  $\frac{3}{8}$ " or Wood Structural Panel (WSP) sheathing


Ensure that the substrate allows for cladding connections that are compliant with the cladding manufacturer installation and connection instructions and meet the applicable building code. See Figure 4 for an illustration of the wall assembly.

**Step 4:** Determine the actual weight for the cladding materials being installed per square foot, as given by the cladding manufacturer specifications.

**Note:**

1. Typical cladding weights are 1.3 psf for vinyl siding, 2.5 psf for cement board siding, 11 psf for Portland cement stucco and 25 psf for adhered masonry veneer; use actual weights for materials installed.
2. Wood furring may add up to 1 psf of additional weight; wood sheathing may add up to 1.5 psf, depending on thickness.

**Step 5:** Using these four values together, find the proper fastening pattern of between 6" and 24" o.c. using Table 3 for Structural H19 and F19 screws and Table 4 for Structural F23 screws.

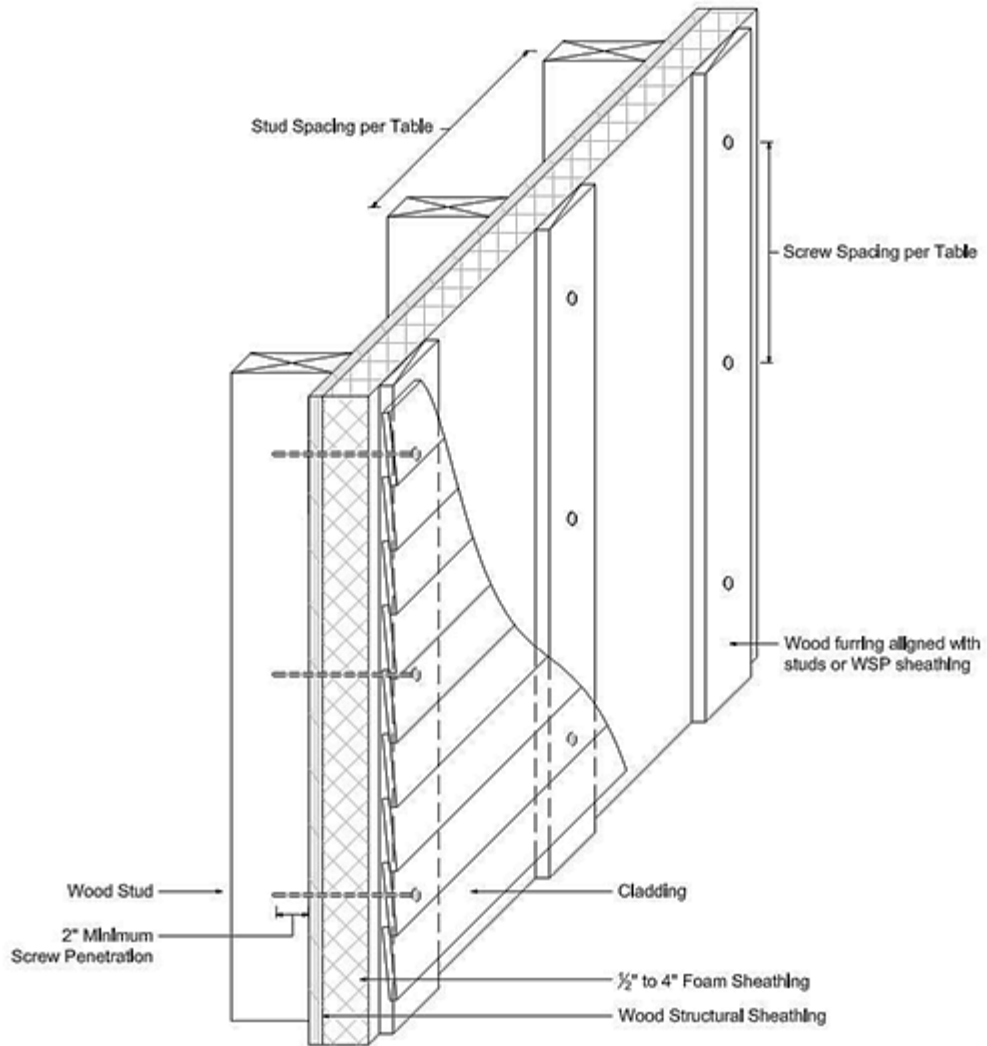

**Figure 4.** Illustration of Exterior Wall Covering Assembly with Vertically Oriented Wood Furring

**Table 3.** Starborn® Structural H19 and F19 Screws: Recommended Fastener Spacing to Support Cladding Weight for Various Thicknesses of Foam Sheathing

Product Name	Stud Spacing (in o.c.)	Min. Fastener Length <sup>8</sup> (in)	Foam Thickness (in)	Maximum Spacing of Fasteners <sup>1,2,4,6,7</sup> (in)											
				Using 3/8" WSP Sheathing <sup>3</sup>						Using 3/4" x 3 1/2" Wood Furring <sup>3</sup>					
				Maximum Cladding Weight <sup>5</sup> (psf)						Maximum Cladding Weight <sup>5</sup> (psf)					
				5	10	15	20	25	30	5	10	15	20	25	30
Structural H19 and F19	16	2 7/8	0.5	24	24	24	24	24	24	-	-	-	-	-	-
		4 (H19 only)	0.5	24	24	24	24	24	24	24	24	24	24	24	24
			1.0	24	24	24	24	20	16	24	24	24	24	20	16
			1.5	24	24	24	20	16	12	-	-	-	-	-	-
		4 1/2 (F19 only)	0.5	24	24	24	24	24	24	24	24	24	24	24	24
			1.0	24	24	24	24	20	16	24	24	24	24	20	16
			1.5	24	24	24	20	16	12	24	24	24	20	16	12
			2.0	24	24	20	16	12	8	-	-	-	-	-	-
		6	1.5	24	24	24	20	16	12	24	24	24	20	16	12
			2.0	24	24	20	16	12	8	24	24	24	16	12	12
			2.5	24	24	16	12	8	8	24	24	20	12	12	8
			3.0	24	20	12	8	8	7	24	24	16	12	8	8
		8	4.0	24	16	8	8	7	5	24	20	12	8	8	6
	24	2 7/8	0.5	24	24	24	24	20	16	-	-	-	-	-	-
		4 (H19 only)	0.5	24	24	24	24	20	16	24	24	24	24	20	16
			1.0	24	24	24	16	12	12	24	24	24	16	12	12
			1.5	24	24	16	12	8	8	-	-	-	-	-	-
		4 1/2 (F19 only)	0.5	24	24	24	24	20	16	24	24	24	24	20	16
			1.0	24	24	24	16	12	12	24	24	24	16	12	12
			1.5	24	24	16	12	8	8	24	24	20	12	12	8
			2.0	24	20	12	8	8	7	-	-	-	-	-	-
		6	1.5	24	24	16	12	8	8	24	24	20	12	12	8
			2.0	24	20	12	8	8	7	24	24	16	12	8	8
			2.5	24	16	12	8	7	6	24	20	12	8	8	8
			3.0	24	12	8	7	6	5	24	16	8	8	7	5
		8	4.0	20	8	7	5	4	-	24	12	8	6	5	4

Product Name	Stud Spacing (in o.c.)	Min. Fastener Length <sup>8</sup> (in)	Foam Thickness (in)	Maximum Spacing of Fasteners <sup>1,2,4,6,7</sup> (in)											
				Using 3/8" WSP Sheathing <sup>3</sup>						Using 3/4" x 3 1/2" Wood Furring <sup>3</sup>					
				Maximum Cladding Weight <sup>5</sup> (psf)						Maximum Cladding Weight <sup>5</sup> (psf)					
				5	10	15	20	25	30	5	10	15	20	25	30

SI: 1 in = 25.4 mm, 1 psf = 0.0479 kN/m<sup>2</sup>

1. Wood framing (studs) shall be a minimum of 2" nominal thickness.
2. Wood framing and furring shall be minimum Spruce-Pine-Fir or any species with specific gravity, SG, of 0.42 or greater.
3. Wood framing, furring, and sheathing shall be designed by others and shall be of adequate size, species, and grade to resist design loads and requirements in accordance with the applicable building code.
4. Furring may be installed vertically or horizontally and shall be installed at the same on-center spacing as the studs. All fasteners shall be installed through the furring and into the studs with a minimum 2" fastener penetration. Alternately, where the furring is installed horizontally, and where the required fastener spacing is 8" o.c. or 12" o.c., the furring may be installed at 16" o.c. or 24" o.c., respectively, provided two (2) fasteners are installed at stud location. Likewise, where the fastener spacing is 6" o.c., the furring may be installed horizontally at 12" o.c. and two (2) fasteners used at each stud. Where multiple fasteners are used, furring or sheathing (substrate) shall be of adequate size to provide proper edge, end, and fastener spacing distances.
5. Maximum allowable cladding weight shall include weight of furring, sheathing, cladding and other supported materials.
6. Furring type and thickness shall be selected based on the cladding manufacturer installation requirements (i.e., required fastener penetration into furring).
7. When using horizontal furring, or where durability of the furring is a concern due to moisture between the cladding and the sheathing, consideration should be given to using preservative treated furring.
8. When choosing the length of fastener, the thickness of the wood framing shall be considered so that the fastener does not penetrate through the backside of the framing stud.

**Table 4. Starborn® Structural F23 Screws: Recommended Fastener Spacing to Support Cladding Weight for Various Thicknesses of Foam Sheathing**

Product Name	Stud Spacing (in o.c.)	Min. Fastener Length <sup>8</sup> (in)	Foam Thickness (in)	Maximum Spacing of Fasteners <sup>1,2,4,6,7</sup> (in)																												
				Using 3/8" WSP Sheathing <sup>3</sup>						Using 3/4" x 3 1/2" Wood Furring <sup>3</sup>																						
				Maximum Cladding Weight <sup>5</sup> (psf)						Maximum Cladding Weight <sup>5</sup> (psf)																						
				5	10	15	20	25	30	5	10	15	20	25	30																	
Structural F23	16	2 7/8	0.5	24						-																						
		4	0.5							24																						
			1.0													-																
			1.5																			-										
			1.5																									24				
		2.0	20							16	24		20	16																		
		2.5	-																													
		2.5								20			16	12	24		20	16	12													
		3.0								16			24				20	16	12	8												
		8								4.0	16	12					8	24														
	2 7/8	0.5	24						-																							
	4	1.0							20						16	24								20	16							
		1.5							-																							
		1.5													-																	
		2.0																						20	16	12	24		20	16		
	2.5	24																						20	16							
	5	2.5							-																							
		3.0							24		20	12	8	24		20	12							8								
		2.5							-																							
		3.0							24		20	12	8			24		20	12	8												
8	4.0	16	12	8	7	6	24		20	12	8	7																				

SI: 1 in = 25.4 mm, 1 psf = 0.0479 kN/m<sup>2</sup>

- Wood framing (studs) shall be a minimum of 2" nominal thickness.
- Wood framing and furring shall be minimum Spruce-Pine-Fir or any species with specific gravity, SG, of 0.42 or greater.
- Wood framing, furring, and sheathing shall be designed by others and shall be of adequate size, species, and grade to resist design loads and requirements in accordance with the applicable building code.
- Furring may be installed vertically or horizontally and shall be installed at the same on-center spacing as the studs. All fasteners shall be installed through the furring and into the studs with a minimum 2" fastener penetration. Alternately, where the furring is installed horizontally, and where the required fastener spacing is 8" o.c. or 12" o.c., the furring may be installed at 16" o.c. or 24" o.c., respectively, provided two (2) fasteners are installed at stud location. Likewise, where the fastener spacing is 6" o.c., the furring may be installed horizontally at 12" o.c. and two (2) fasteners used at each stud. Where multiple fasteners are used, furring or sheathing (substrate) shall be of adequate size to provide proper edge, end, and fastener spacing distances.
- Maximum allowable cladding weight shall include weight of furring, sheathing, cladding and other supported materials.
- Furring type and thickness shall be selected based on the cladding manufacturer installation requirements (i.e., required fastener penetration into furring).
- When using horizontal furring, or where durability of the furring is a concern due to moisture between the cladding and the sheathing, consideration should be given to using preservative treated furring.
- When choosing the length of fastener, the thickness of the wood framing shall be considered so that the fastener does not penetrate through the backside of the framing stud.

- 5.4 Where the application falls outside of the performance evaluation, conditions of use and/or installation requirements set forth herein, alternative techniques shall be permitted in accordance with accepted engineering practice and experience. This includes but is not limited to the following areas of engineering: mechanics or materials, structural, building science, and fire science.

## 6 Installation

- 6.1 Installation shall comply with the approved construction documents, the manufacturer installation instructions, this TER and the applicable building code.
- 6.2 In the event of a conflict between the manufacturer installation instructions and this TER, the more restrictive shall govern.
- 6.3 *Installation Procedure*
- 6.3.1 Starborn® Structural H19, F19 and F23 screws shall be installed using a high-torque, low-speed drill in accordance with the manufacturer installation instructions, applicable code, the approved construction documents, this TER, NDS, and standard framing practice as applied to wood fasteners.
- 6.3.2 The fasteners must be installed using a  $\frac{5}{16}$ " hex, Torx® T-30 or Torx® T-40 star drive bit depending on the fastener used. Pre-drilling of pilot holes is not required but may be used where lumber is prone to splitting.
- 6.3.3 Fasteners should be aligned perpendicular to the face of the wall stud so that the point engages the center of the wall stud and at a minimum distance of 3" from the end of the stud or furring material.
- 6.3.4 Fasteners must be installed in a manner to avoid over-driving yet snug enough to remove any gaps between the layers of materials being fastened.
- 6.3.5 For applications outside the scope of this TER, an engineered design is required.
- 6.3.6 All fastener spacing, edge distance, and end distance shall be as determined in Table 5, Table 6, and Figure 5.

**Table 5.** Starborn® Structural Screw Edge and End Distance Requirements for 0.19" Screw

Number	Installed Condition	Minimum Distance or Spacing <sup>1,2</sup> (in)		
		Face	Edge	End
1	Minimum End Distance	6	3	1 $\frac{3}{4}$
2	Minimum Edge Distance	1 $\frac{3}{4}$	$\frac{3}{4}$	$\frac{3}{4}$
3	Minimum Spacing Between Fasteners in a Row	2 $\frac{7}{8}$	2 $\frac{7}{8}$	2 $\frac{7}{8}$
4	Minimum Spacing Between Non-Staggered Rows	2 $\frac{7}{8}$	NA	NA
5	Minimum Spacing Between Staggered Rows	$\frac{1}{2}$	NA	NA
6	Minimum Stagger Between Fasteners in Adjacent Rows	$\frac{1}{2}$	NA	NA

SI: 1 in = 25.4 mm

1. Table values based on 0.19" screw.

2. Edge distances, end distances, and spacing of fasteners shall be sufficient to prevent splitting of the wood or as shown in this table, whichever is more restrictive.


**Table 6.** Starborn® Structural Screw Edge and End Distance for 0.23" Diameter Screw

Number	Installed Condition	Minimum Distance or Spacing <sup>1,2</sup> (in)		
		Face	Edge	End
1	Minimum End Distance	6	3	1¾
2	Minimum Edge Distance	1¾	¾	¾
3	Minimum Spacing Between Fasteners in a Row	3½	3½	3½
4	Minimum Spacing Between Non-Staggered Rows	3½	NA	NA
5	Minimum Spacing Between Staggered Rows	5/8	NA	NA
6	Minimum Stagger Between Fasteners in Adjacent Rows	5/8	NA	NA

SI: 1 in = 25.4 mm

1. Table values based on 0.23" screw.

2. Edge distances, end distances, and spacing of fasteners shall be sufficient to prevent splitting of the wood or as shown in this table, whichever is more restrictive.

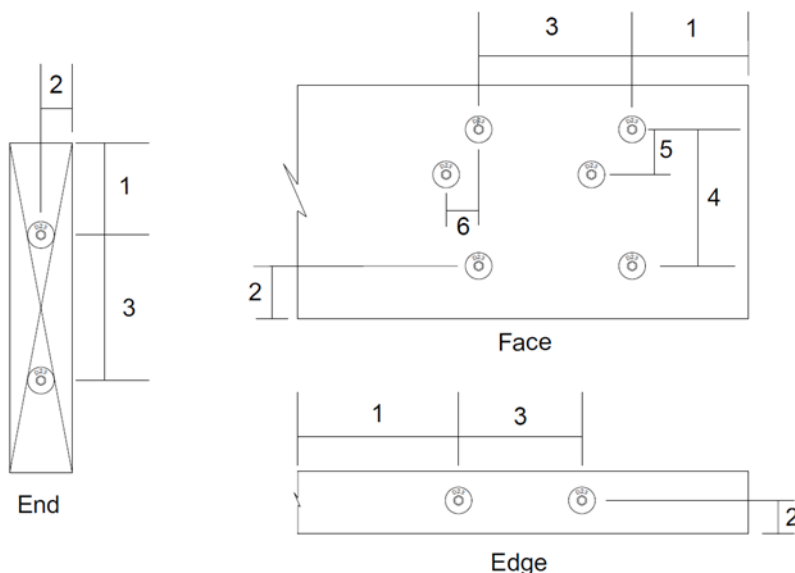

**Figure 5.** Starborn® Structural H19, F19 and F23 Edge and End Distance Requirements

## 7 Substantiating Data

- 7.1 Testing has been performed under the supervision of a professional engineer and/or under the requirements of ISO/IEC 17025 as follows:
- 7.1.1 ANSI/AWC NDS: *National Design Specification (NDS) for Wood Construction*
  - 7.1.2 Testing conducted for the Foam Sheathing Committee,<sup>9</sup> the Steel Framing Alliance, and the New York State Energy Research and Development Authority (NYSERDA).
  - 7.1.3 Testing conducted for the Foam Sheathing Committee by Progressive Engineering, Inc.; *Evaluation of Siding Attachment Methods Using Various Materials*, Test Report #2010-128.
  - 7.1.4 Material properties and design values in accordance with TER 1703-05.
  - 7.1.5 Cladding weight design value calculations by DrJ Engineering, LLC.

<sup>9</sup> Formerly the Foam Sheathing Coalition

- 7.2 Information contained herein may include the result of testing and/or data analysis by sources that are approved agencies (i.e., ANAB accredited agencies), approved sources (i.e., RDPs), and/or professional engineering regulations. Accuracy of external test data and resulting analysis is relied upon.
- 7.3 Where pertinent, testing and/or engineering analysis is based upon provisions that have been codified into law through state or local adoption of codes and standards. The developers of these codes and standards are responsible for the reliability of published content. DrJ's engineering practice may use a code-adopted provision as the control sample. A control sample versus a test sample establishes a product as being equivalent to the code-adopted provision in terms of quality, strength, effectiveness, fire resistance, durability, and safety.
- 7.4 The accuracy of the provisions provided herein may be reliant upon the published properties of raw materials, which are defined by the grade mark, grade stamp, mill certificate, Listings, certified reports, duly authenticated reports from approved agencies, and research reports prepared by approved agencies and/or approved sources provided by the suppliers of products, materials, designs, assemblies and/or methods of construction. These are presumed to be minimum properties and relied upon to be accurate. The reliability of DrJ's engineering practice, as contained in this TER, may be dependent upon published design properties by others.
- 7.5 Testing and engineering analysis: The strength, rigidity and/or general performance of component parts and/or the integrated structure are determined by suitable tests that simulate the actual conditions of application that occur and/or by accepted engineering practice and experience.<sup>10</sup>
- 7.6 Where additional condition of use and/or code compliance information is required, please search for Starborn® Structural H19 Screws, Starborn® Structural F19 Screws and Starborn® Structural F23 Screws on the DrJ Certification website.

## 8 Findings

- 8.1 As delineated in Section 3, Starborn® Structural H19 Screws, Starborn® Structural F19 Screws and Starborn® Structural F23 Screws have performance characteristics that were tested and/or meet pertinent standards and is suitable for use pursuant to its specified purpose.
- 8.2 When used and installed in accordance with this TER and the manufacturer installation instructions, Starborn® Structural H19 Screws, Starborn® Structural F19 Screws and Starborn® Structural F23 Screws shall be approved for the following applications:
- 8.2.1 Starborn® Structural H19, F19 and F23 screws are acceptable for use as an alternative material, design, and method of construction for the attachment of furring, sheathing, or cladding over foam sheathing and into wood framing:
- 8.2.1.1 Starborn® Structural H19, F19 and F23 screws evaluated herein and installed in accordance with this TER meet the requirements of the listed editions of the IRC for positive and negative wind pressure resistance.
- 8.2.1.2 Starborn® Structural H19, F19 and F23 screws evaluated herein and installed in accordance with this TER meet the requirements of the listed editions of the IRC for lateral shear strength to support cladding materials installed over foam sheathing.
- 8.2.1.3 Starborn® Structural H19, F19 and F23 screws evaluated herein and installed in accordance with this TER meet the requirements of the listed editions of the IBC for positive and negative wind pressure resistance.
- 8.2.1.4 Starborn® Structural H19, F19 and F23 screws evaluated herein and installed in accordance with this TER meet the requirements of the listed editions of the IBC for lateral shear strength to support cladding materials installed over foam sheathing.

<sup>10</sup> See Code of Federal Regulations (CFR) Title 24 Subtitle B Chapter XX Part 3280 for definition.

- 8.3 These products have been evaluated in the context of the codes listed in Section 2 and are compliant with all known state and local building codes. Where there are known variations in state or local codes applicable to this TER, they are listed here:

8.3.1 No known variations

- 8.4 Any application specific issues not addressed herein can be engineered by an RDP. Assistance with engineering is available from Starborn® Industries, Inc.

- 8.5 IBC Section 104.11 (IRC Section R104.11 and IFC Section 104.10<sup>11</sup> are similar) in pertinent part states:

**104.11 Alternative materials, design and methods of construction and equipment.** The provisions of this code are not intended to prevent the installation of any material or to prohibit any design or method of construction not specifically prescribed by this code. Where the alternative material, design or method of construction is not approved, the building official shall respond in writing, stating the reasons the alternative was not approved.

- 8.6 **Approved:**<sup>12</sup> Building codes require that the building official shall accept duly authenticated reports<sup>13</sup> or research reports<sup>14</sup> from approved agencies and/or approved sources (i.e., licensed RDP) with respect to the quality and manner of use of new products, materials, designs, services, assemblies, or methods of construction.

- 8.6.1 Acceptability of an approved agency, by a building official, is performed by verifying that the agency is accredited by a recognized accreditation body of the International Accreditation Forum (IAF).

- 8.6.2 Acceptability of a licensed RDP, by a building official, is performed by verifying that the RDP and/or their business entity is listed by the licensing board of the relevant jurisdiction.

- 8.6.3 Federal law, Title 18 US Code Section 242, requires that where the alternative product, material, service, design, assembly, and/or method of construction is not approved, the building official shall respond in writing, stating the reasons why the alternative was not approved, as denial without written reason deprives a protected right to free and fair competition in the marketplace.

- 8.7 DrJ is an engineering company, employs RDPs and is an ISO/IEC 17065 ANAB-Accredited Product Certification Body – Accreditation #1131.

- 8.8 Through ANAB accreditation and the IAF Multilateral Agreements, this TER can be used to obtain product approval in any jurisdiction or country that has IAF MLA Members & Signatories to meet the Purpose of the MLA – “certified once, accepted everywhere.” IAF specifically says, *“Once an accreditation body is a signatory of the IAF MLA, it is required to recognise certificates and validation and verification statements issued by conformity assessment bodies accredited by all other signatories of the IAF MLA, with the appropriate scope.”*<sup>15</sup>

## 9 Conditions of Use

- 9.1 Material properties shall not fall outside the boundaries defined in Section 3.
- 9.2 As defined in Section 3, where material and/or engineering mechanics properties are created for load resisting design purposes, the resistance to the applied load shall not exceed the ability of the defined properties to resist those loads using the principles of accepted engineering practice.
- 9.3 Starborn® Structural H19, F19 and F23 screws covered in this TER shall be installed in accordance with this TER and the manufacturer installation instructions.

---

<sup>11</sup> 2018 IFC Section 104.9

<sup>12</sup> Approved is an adjective that modifies the noun after it. For example, Approved Agency means that the Agency is accepted officially as being suitable in a particular situation. This example conforms to IBC/IRC/IFC Section 201.4 where the building code authorizes sentences to have an ordinarily accepted meaning such as the context implies.

<sup>13</sup> <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1707.1>

<sup>14</sup> <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1703.4.2>

<sup>15</sup> <https://iaf.nu/en/about-iaf-mla/#:~:text=required%20to%20recognise>

- 9.4 For conditions not covered in this TER, connections shall be designed in accordance with generally accepted engineering practice. When the capacity of a connection is controlled by fastener metal strength rather than wood strength, the metal strength must not be multiplied by the adjustment factors specified in the NDS.
- 9.5 Use of fasteners in locations exposed to saltwater or saltwater spray is outside the scope of this evaluation report.
- 9.6 Starborn® Structural H19, F19 and F23 screws are produced by Starborn® Industries, Inc. at its facilities located in Edison, New Jersey.
- 9.7 Starborn® Structural H19, F19 and F23 screws are produced under a quality control program subject to periodic inspections performed by an approved agency in accordance with [IBC Section 1703.5.2](#).
- 9.8 Install fasteners prior to utility installations in exterior walls to avoid accidental penetration of utilities (i.e., electrical wiring, plumbing, etc.).
- 9.9 Foam sheathing shall be minimum Type II (expanded polystyrene) or Type X (extruded polystyrene) per ASTM C578 or Type 1 (polyiso) per ASTM C1289.
  - 9.9.1 Types with greater compressive strength are acceptable.
- 9.10 Ensure furring or sheathing material provides adequate substrate and thickness for the application of the siding fastener per the code requirements for siding application and the siding manufacturer installation instructions.
  - 9.10.1 For example, if the siding manufacturer requires the fastener for the siding to penetrate more than  $\frac{3}{4}$ " into the furring, a 1" x 4" furring strip (actual dimension of  $\frac{3}{4}$ " x  $3\frac{1}{2}$ ") would not be adequate, and a thicker furring strip, such as a 2" x 4", would be required.
- 9.11 When required by adopted legislation and enforced by the [building official](#), also known as the authority having jurisdiction (AHJ) in which the project is to be constructed:
  - 9.11.1 Any calculations incorporated into the construction documents shall conform to accepted engineering practice, and, when prepared by an [approved source](#), shall be approved when requirements of adopted legislation are met.
  - 9.11.2 This TER and the installation instructions shall be submitted at the time of [permit](#) application.
  - 9.11.3 These products have an internal quality control program and a third-party quality assurance program.
  - 9.11.4 At a minimum, these products shall be installed per Section 6 of this TER.
  - 9.11.5 The review of this TER, by the AHJ, shall be in compliance with [IBC Section 104](#) and [IBC Section 105.4](#).
  - 9.11.6 These products have an internal quality control program and a third party quality assurance program in accordance with [IBC Section 104.4](#), [IBC Section 110.4](#), [IBC Section 1703](#), [IRC Section R104.4](#) and [IRC Section R109.2](#).
  - 9.11.7 The application of these products in the context of this TER is dependent upon the accuracy of the construction documents, implementation of installation instructions, inspection as required by [IBC Section 110.3](#), [IRC Section R109.2](#) and any other regulatory requirements that may apply.
- 9.12 The approval of this TER by the AHJ shall comply with [IBC Section 1707.1](#), where legislation states in pertinent part, "*the [building official](#) shall accept duly authenticated reports from [approved agencies](#) in respect to the quality and manner of [use](#) of new materials or assemblies as provided for in [Section 104.11](#)*", all of [IBC Section 104](#), and [IBC Section 105.4](#).
- 9.13 [Design loads](#) shall be determined in accordance with the building code adopted by the [jurisdiction](#) in which the project is to be constructed and/or by the building designer (i.e., [owner](#) or RDP).
- 9.14 The actual design, suitability, and use of this TER, for any particular building, is the responsibility of the [owner](#) or the owner's authorized agent.



## 10 Identification

- 10.1 The products listed in Section 1.1 are identified by a label on the board or packaging material bearing the manufacturer name, product name, TER number, and other information to confirm code compliance.
- 10.2 Additional technical information can be found at [starbornindustries.com](http://starbornindustries.com).

## 11 Review Schedule

- 11.1 This TER is subject to periodic review and revision. For the most recent version, visit [drjcertification.org](http://drjcertification.org).
- 11.2 For information on the status of this TER, contact [DrJ Certification](http://DrJ Certification).

## 12 Approved for Use Pursuant to US and International Legislation Defined in Appendix A

- 12.1 Starborn® Structural H19 Screws, Starborn® Structural F19 Screws and Starborn® Structural F23 Screws are included in this TER published by an approved agency that is concerned with evaluation of products or services, maintains periodic inspection of the production of listed materials or periodic evaluation of services, and whose TER Listing states either that the material, product, or service meets identified standards or has been tested and found suitable for a specified purpose. This TER meets the legislative intent and definition of being acceptable to the AHJ.

## Appendix A

### 1 Legislation that Authorizes AHJ Approval

- 1.1 **Fair Competition:** State legislatures have adopted Federal regulations for the examination and approval of building code referenced and alternative products, materials, designs, services, assemblies and/or methods of construction that:
  - 1.1.1 Advance Innovation,
  - 1.1.2 Promote competition so all businesses have the opportunity to compete on price and quality in an open market on a level playing field unhampered by anticompetitive constraints, and
  - 1.1.3 Benefit consumers through lower prices, better quality, and greater choice.
- 1.2 **Adopted Legislation:** The following local, state, and federal regulations affirmatively authorize Starborn® Structural H19 Screws, Starborn® Structural F19 Screws and Starborn® Structural F23 Screws to be approved by AHJs, delegates of building departments, and/or delegates of an agency of the federal government:
  - 1.2.1 Interstate commerce is governed by the Federal Department of Justice to encourage the use of innovative products, materials, designs, services, assemblies and/or methods of construction. The goal is to “protect economic freedom and opportunity by promoting free and fair competition in the marketplace.”
  - 1.2.2 Title 18 US Code Section 242 affirms and regulates the right of individuals and businesses to freely and fairly have new products, materials, designs, services, assemblies and/or methods of construction approved for use in commerce. Disapproval of alternatives shall be based upon non-conformance with respect to specific provisions of adopted legislation, and shall be provided in writing stating the reasons why the alternative was not approved, with reference to the specific legislation violated.
  - 1.2.3 The federal government and each state have a public records act. In addition, each state also has legislation that mimics the federal Defend Trade Secrets Act 2016 (DTSA).
    - 1.2.3.1 Compliance with public records and trade secret legislation requires approval through the use of listings, certified reports, Technical Evaluation Reports, duly authenticated reports and/or research reports prepared by approved agencies and/or approved sources.
  - 1.2.4 For new materials<sup>16</sup> that are not specifically provided for in any building code, the design strengths and permissible stresses shall be established by tests, where suitable load tests simulate the actual loads and conditions of application that occur.
  - 1.2.5 The design strengths and permissible stresses of any structural material shall conform to the specifications and methods of design using accepted engineering practice.<sup>17</sup>
  - 1.2.6 The commerce of approved sources (i.e., registered PEs) is regulated by professional engineering legislation. Professional engineering commerce shall always be approved by AHJs, except where there is evidence, provided in writing, that specific legislation has been violated by an individual registered PE.
  - 1.2.7 The AHJ shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in IBC Section 104.11.<sup>18</sup>

<sup>16</sup> <https://up.codes/viewer/wyoming/ibc-2021/chapter/17/special-inspections-and-tests#1706.2>

<sup>17</sup> IBC 2021, Section 1706.1 Conformance to Standards

<sup>18</sup> IBC 2021, Section 1707 Alternative Test Procedure, 1707.1 General

- 1.3 **Approved<sup>19</sup> by Los Angeles:** The Los Angeles Municipal Code (LAMC) states in pertinent part that the provisions of LAMC are not intended to prevent the use of any material, device, or method of construction not specifically prescribed by LAMC. The Department shall use Part III, Recognized Standards in addition to Part II, Uniform Building Code Standards of Division 35, Article 1, Chapter IX of the LAMC in evaluation of products for approval where such standard exists for the product or the material and may use other approved standards, which apply. Whenever tests or certificates of any material or fabricated assembly are required by Chapter IX of the LAMC, such tests or certification shall be made by a testing agency approved by the Superintendent of Building to conduct such tests or provide such certifications. The testing agency shall publish the scope and limitation(s) of the listed material or fabricated assembly.<sup>20</sup> The Superintendent of Building roster of approved testing agencies is provided by the Los Angeles Department of Building and Safety (LADBS). The Center for Building Innovation (CBI) Certificate of Approval License is TA24945. Tests and certifications found in a CBI Listing are LAMC approved. In addition, the Superintendent of Building shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in the California Building Code (CBC) Section 1707.1.<sup>21</sup>
- 1.4 **Approved by Chicago:** The Municipal Code of Chicago (MCC) states in pertinent part that an Approved Agency is a Nationally Recognized Testing Laboratory (NRTL) acting within its recognized scope and/or a certification body accredited by the American National Standards Institute (ANSI) acting within its accredited scope. Construction materials and test procedures shall conform to the applicable standards listed in the MCC. Sufficient technical data shall be submitted to the building official to substantiate the proposed use of any product, material, service, design, assembly and/or method of construction not specifically provided for in the MCC. This technical data shall consist of research reports from approved sources (i.e., MCC defined Approved Agencies).
- 1.5 **Approved by New York City:** The NYC Building Code 2022 (NYCBC) states in pertinent part that an approved agency shall be deemed<sup>22</sup> an approved testing agency via ISO/IEC 17025 accreditation, an approved inspection agency via ISO/IEC 17020 accreditation, and an approved product evaluation agency via ISO/IEC 17065 accreditation. Accrediting agencies, other than federal agencies, must be members of an internationally recognized cooperation of laboratory and inspection accreditation bodies subject to a mutual recognition agreement<sup>23</sup> (i.e., ANAB, International Accreditation Forum (IAF), etc.).

<sup>19</sup> See Section 8 for the distilled building code definition of **Approved**

<sup>20</sup> Los Angeles Municipal Code, SEC. 98.0503. TESTING AGENCIES

<sup>21</sup> <https://up.codes/viewer/california/ca-building-code-2022/chapter/17/special-inspections-and-tests#1707.1>

<sup>22</sup> New York City, The Rules of the City of New York, § 101-07 Approved Agencies

<sup>23</sup> New York City, The Rules of the City of New York, § 101-07 Approved Agencies

- 1.6 **Approved by Florida:** Statewide approval of products, methods, or systems of construction shall be approved, without further evaluation, by 1) A certification mark or listing of an approved certification agency, 2) A test report from an approved testing laboratory, 3) A product evaluation report based upon testing or comparative or rational analysis, or a combination thereof, from an approved product evaluation entity; 4) A product evaluation report based upon testing or comparative or rational analysis, or a combination thereof, developed and signed and sealed by a professional engineer or architect, licensed in Florida. For local product approval, products or systems of construction shall demonstrate compliance with the structural wind load requirements of the Florida Building Code (FBC) through one of the following methods; 1) A certification mark, listing, or label from a commission-approved certification agency indicating that the product complies with the code; 2) A test report from a commission-approved testing laboratory indicating that the product tested complies with the code; 3) A product-evaluation report based upon testing, comparative or rational analysis, or a combination thereof, from a commission-approved product evaluation entity which indicates that the product evaluated complies with the code; 4) A product-evaluation report or certification based upon testing or comparative or rational analysis, or a combination thereof, developed and signed and sealed by a Florida professional engineer or Florida registered architect, which indicates that the product complies with the code; 5) A statewide product approval issued by the Florida Building Commission. The Florida Department of Business and Professional Regulation (DBPR) website provides a listing of companies certified as a Product Evaluation Agency (i.e., EVLMiami 13692), a Product Certification Agency (i.e., CER10642), and as a Florida Registered Engineer (i.e., ANE13741).
- 1.7 **Approved by Miami-Dade County (i.e., Notice of Acceptance [NOA]):** A Florida statewide approval is an NOA. An NOA is a Florida local product approval. By Florida law, Miami-Dade County shall accept the statewide and local Florida Product Approval as provided for in Florida legislation 553.842 and 553.8425.
- 1.8 **Approved by New Jersey:** Pursuant to Building Code 2018 of New Jersey in IBC Section 1707.1 General,<sup>24</sup> it states: “In the absence of approved rules or other approved standards, the building official shall accept duly authenticated reports from approved agencies in respect to the quality and manner of use of new materials or assemblies as provided for in the administrative provisions of the Uniform Construction Code (N.J.A.C. 5:23)”.<sup>25</sup> Furthermore N.J.A.C 5:23-3.7 states: Municipal approvals of alternative materials, equipment, or methods of construction. **(a) Approvals:** Alternative materials, equipment, or methods of construction shall be approved by the appropriate subcode official provided the proposed design is satisfactory and that the materials, equipment, or methods of construction are suitable for the intended use and are at least the equivalent in quality, strength, effectiveness, fire resistance, durability and safety of those conforming with the requirements of the regulations. 1. A field evaluation label and report or letter issued by a nationally recognized testing laboratory verifying that the specific material, equipment, or method of construction meets the identified standards or has been tested and found to be suitable for the intended use, shall be accepted by the appropriate subcode official as meeting the requirements of (a) above. 2. Reports of engineering findings issued by nationally recognized evaluation service programs, such as, but not limited to, the Building Officials and Code Administrators (BOCA), the International Conference of Building Officials (ICBO), the Southern Building Code Congress International (SBCCI), the International Code Council (ICC), and the National Evaluation Service, Inc., shall be accepted by the appropriate subcode official as meeting the requirements of (a) above. The New Jersey Department of Community Affairs has confirmed that technical evaluation reports, from any accredited entity listed by ANAB, meets the requirements of item 2 given that the listed entities are no longer in existence and/or do not provide “reports of engineering findings”.

<sup>24</sup> [https://up.codes/viewer/new\\_jersey/ibc-2018/chapter/17/special-inspections-and-tests#1707.1](https://up.codes/viewer/new_jersey/ibc-2018/chapter/17/special-inspections-and-tests#1707.1)

<sup>25</sup> <https://www.nj.gov/dca/divisions/codes/codereg/ucc.html>

- 1.9 **Approved by the Code of Federal Regulations Manufactured Home Construction and Safety Standards:** Pursuant to Title 24, Subtitle B, Chapter XX, Part 3282.14<sup>26</sup> and Part 3280,<sup>27</sup> the Department encourages innovation and the use of new technology in manufactured homes. The design and construction of a manufactured home shall conform with the provisions of Part 3282 and Part 3280 where key approval provisions in mandatory language follow: 1) “All construction methods shall be in conformance with accepted engineering practices”; 2) “The strength and rigidity of the component parts and/or the integrated structure shall be determined by engineering analysis or by suitable load tests to simulate the actual loads and conditions of application that occur.”; and 3) “The design stresses of all materials shall conform to accepted engineering practice.”
- 1.10 **Approval by US, Local, and State Jurisdictions in General:** In all other local and state jurisdictions, the adopted building code legislation states in pertinent part that:
- 1.10.1 For new materials that are not specifically provided for in this code, the design strengths and permissible stresses shall be established by tests.<sup>28</sup>
  - 1.10.2 For innovative alternative products, materials, designs, services and/or methods of construction, in the absence of approved rules or other approved standards...the building official shall accept duly authenticated reports (i.e., listing and/or research report) from approved agencies with respect to the quality and manner of use of new materials or assemblies.<sup>29</sup> A building official approved agency is deemed to be approved via certification from an accreditation body that is listed by the International Accreditation Forum<sup>30</sup> or equivalent.
  - 1.10.3 The design strengths and permissible stresses of any structural material...shall conform to the specifications and methods of design of accepted engineering practice performed by an approved source.<sup>31</sup> An approved source is defined as a PE subject to professional engineering laws, where a research and/or a technical evaluation report certified by a PE, shall be approved.
- 1.11 **Approval by International Jurisdictions:** The USMCA and GATT agreements provide for approval of innovative materials, products, designs, services, assemblies and/or methods of construction through the Technical Barriers to Trade agreements and the International Accreditation Forum (IAF) Multilateral Recognition Arrangement (MLA), where these agreements:
- 1.11.1 Permit participation of conformity assessment bodies located in the territories of other Members (defined as GATT Countries) under conditions no less favourable than those accorded to bodies located within their territory or the territory of any other country,
  - 1.11.2 State that conformity assessment procedures (i.e., ISO/IEC 17020, 17025, 17065, etc.) are prepared, adopted, and applied so as to grant access for suppliers of like products originating in the territories of other Members under conditions no less favourable than those accorded to suppliers of like products of national origin or originating in any other country, in a comparable situation.
  - 1.11.3 State that conformity assessment procedures are not prepared, adopted, or applied with a view to or with the effect of creating unnecessary obstacles to international trade. This means that conformity assessment procedures shall not be more strict or be applied more strictly than is necessary to give the importing Member adequate confidence that products conform to the applicable technical regulations or standards.

<sup>26</sup> <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3282/subpart-A/section-3282.14>

<sup>27</sup> <https://www.ecfr.gov/current/title-24/subtitle-B/chapter-XX/part-3280>

<sup>28</sup> IBC 2021, Section 1706 Design Strengths of Materials, 1706.2 New Materials. Adopted law pursuant to IBC model code language 1706.2.

<sup>29</sup> IBC 2021, Section 1707 Alternative Test Procedure, 1707.1 General. Adopted law pursuant to IBC model code language 1707.1.

<sup>30</sup> Please see the ANAB directory for building official approved agencies.

<sup>31</sup> IBC 2021, Section 1706 Design Strengths of Materials, Section 1706.1 Conformance to Standards Adopted law pursuant to IBC model code language 1706.1.



- 1.11.4 **Approved:** The purpose of the IAF MLA is to ensure mutual recognition of accredited certification and validation/verification statements between signatories to the MLA, and subsequently acceptance of accredited certification and validation/verification statements in many markets based on one accreditation for the timely approval of innovative materials, products, designs, services, assemblies and/or methods of construction. Accreditations granted by IAF MLA signatories are recognised worldwide based on their equivalent accreditation programs, therefore reducing costs and adding value to businesses and consumers.